



KELLY 5010 SX BLOWER



**EUROPEAN
WARRANTY**

MATERIAL:

- Vertical collectors in painted mild steel \varnothing 38 mm.
- Horizontal heating elements in painted mild steel 50x10 mm.
- Heat transfer fluid.

ELECTRIC MODULE FOR VENTILATED FUNCTION:

Fan heater with integrated PID electronic controller; with presence / absence detector, Open window detector; self-learning and self-programming function optimized with priority on comfort or energy saving.
Power 1000 Watt - 230 V 50 Hz • On / Off Switch • Temperature settings: +10°C to + 30°C.

FIXING KIT:

Brackets, hexagonal tool, plugs and screws for mounting suitable for use on compact or hollow brick walls, user notice.
The kit is certified from TÜV in compliance with VDI 6036 - class 4.

FUNCTIONING:

- Electric
- With BLOWER electric module
- Blower dual energy

PACKAGING:

The radiator is protected by recyclable carton box. User notice included.

PAINTING PROCESS:

Painted with ecological epoxy powders (Certificate DIN 55900-1,-2).

COLOURS:

See colour chart.

ACCESSORIES:

For the complete list, please refer to the accessories chapter.

Class protection: CLASS 2

Minimum ingress protection: IP 24


Wire length: 1100 mm with Schuko plug

Seasonal energy efficiency η_s : 39%

CERTIFICATES



HOW TO PLACE ELECTRIC RADIATORS

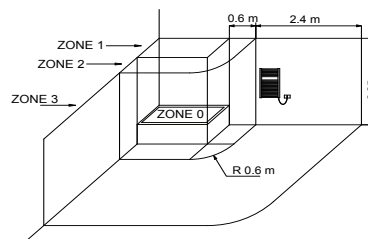

The national rules on installing electrical equipment in the bathroom must be scrupulously respected. The electric radiators must be always installed outside zone 1 and 2.

In particular the electric switch and control elements must be mandatorily located in zone 3, in order that no electrical control center is accessible to a anyone using the shower or bath.



All Cordivari electric radiators are in line with the new European regulation UE 2015/1188. The new regulation imposes a seasonal energy efficiency of electrical appliances for ambient heating with a nominal thermal output over 250 W and not less than 38%. Each of the ErP electric radiator is equipped with at least electronic temperature control, window opening detection and weekly programmer.


OPTIONAL

RF WIRELESS REMOTE CONTROL



Remote control of "BLOWER" ventilated functioning

Art. nr. 515099000011

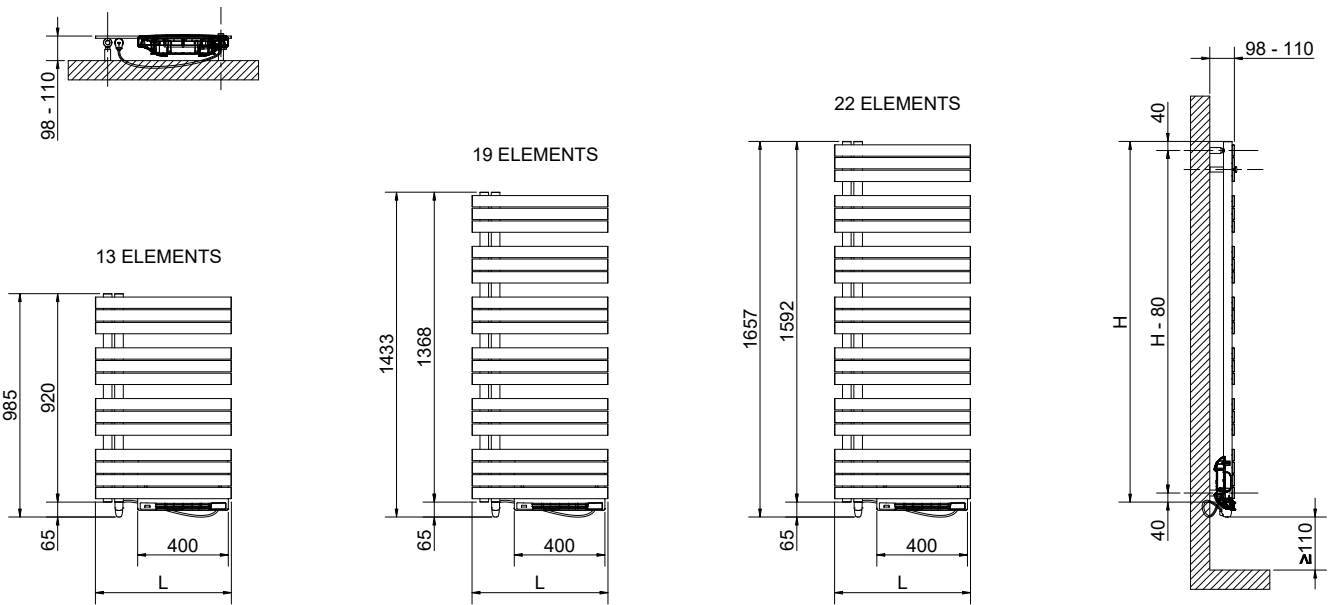

KELLY 5010 SX BLOWER

Height [mm]	Width L [mm]	Art. nr.	Output [Watt]	BLOWER output [Watt]	Weight [Kg]
920	600	3581726100159	500	1000	20
1368	600	3581726100160	750	1000	27
1592	600	3581726100161	1000	1000	31

Art. nr. are referred to colour WHITE R01

ELECTRIC MODULE FOR VENTILATION

The Cordivari thermo-ventilation Blower module offers advanced features for maximum comfort without wasting energy with the aim of simplifying the user's life



- Open window detector
- Energy saving priority with presence / absence detector
- Dual function optimization with priority on comfort or energy saving depending on the priority chosen by the user. The device calculates and optimizes the programming for each heating period, set on Comfort or Economy (Eco) based on the choice made by the user.
- Active memory of settings in case the mains power fails for up to 16 hours

For the radiators manufactured in coloured version different from standard white the "Blower" electric module for ventilated function is provided in grey finishing.

DESIGN, ERGONOMICS AND PRACTICALITY

- Ultra-discreet design with excellent ergonomic settings
- Remote control via radio remote control (optional)
- Energy consumption indicator and detector
- Weekly and daily programming
- Child protection
- Dust filter removable at any time from both sides of the radiator, for maximum ease and effectiveness of sanitization.

COMFORT & SMART LIVING

- High precision "intelligent" electronic PID regulation for a stable and accurate bath temperature all year round
- Boost mode, adjustable up to 90 minutes, in 10-minute intervals, to speed up bathroom heating and super comfort (with automatic boost) for instant additional heating.
- Adaptive intelligent self-learning function of the user's rhythm and lifestyle: learning is continuous thanks to an intelligent algorithm that analyzes information in real time to optimize and adapt the program to the following weeks.